


SY32/SY42 PLY TO PLY LSC CONNECTION DETAIL FOR DOWNWARD LOADS ONLY


Uniform Load Application

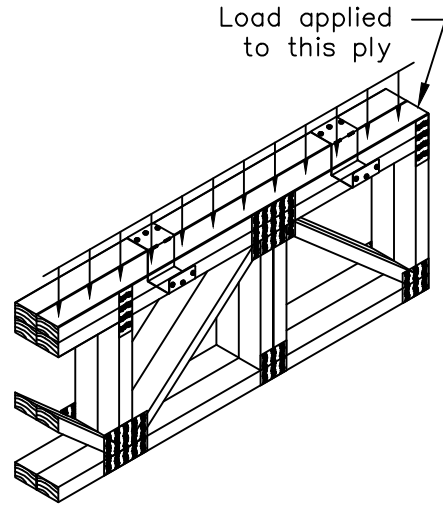

Max. T.C. Uniform Load (plf)			Clip Spacing Along Top Chord
SP	DF	SPF/HF	
935	810	585	12' o.c.
625	540	390	18' o.c.
470	405	295	24' o.c.
375	325	235	30' o.c.

Maximum LSC spacing is 30" o.c.

Concentrated Load Application

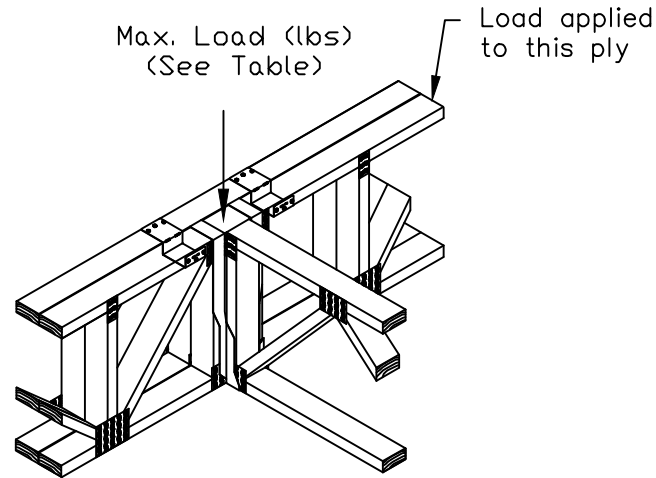


Max Load (lbs)		
SP	DF	SPF/HF
1870	1620	1170

Note:
Install LSC adjacent, equidistant, and not more than 6" on each side of concentrated load.

Installation Instructions:

1. Position and attach LSC to loaded ply with (3) 0.131"x1.5" nails into narrow face.
2. Bend clip over adjacent ply and attach with (3) 0.131"x1.5" nails into wide face.



LSC42 for single 4x2 chords
LSC32 for single 3x2 chords



LSC42-2 for stacked 4x2 chords
LSC32-2 for stacked 3x2 chords

Refer to Alpine sealed drawing for individual truss design.



514 Earth City Expressway
Suite 242
Earth City, MO 63045

WARNING READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this job's general notes page and these web sites:
ALPINE: www.alpineitw.com TPI: www.tpinst.org SBCA: www.sbcacomponents.com ICC: www.iccsafe.org

REF SY42 Connection
DATE 10/01/14
DRWG LSCSYX2A1014

DUR. FAC.

ALL