


RIGID INSERT DETAIL - REINFORCEMENT FOR HIGH STRESS COMPRESSION JOINTS

THIS DETAIL IS TO BE USED WHEN STRESS AT A COMPRESSION SPLICE EXCEEDS 75% OF THE ALLOWABLE COMPRESSION STRESS PER TPI 1 SECTION 7.3.9.2


OPTION #1:

APPLY A 20 GAGE MINIMUM METAL INSERT BETWEEN BUTTED ENDS OF COMPRESSION CHORD MEMBERS TO FULLY COVER THE JOINT BEARING AREA. BEND RIGID INSERT OVER THE TOP OR BOTTOM OF THE COMPRESSION MEMBER A MINIMUM OF 1" AND SECURE IN PLACE WITH A KEEPER NAIL. KEEPER NAIL IS TO BE SIZED AND SPACED TO AVOID SPLITTING OF THE LUMBER.

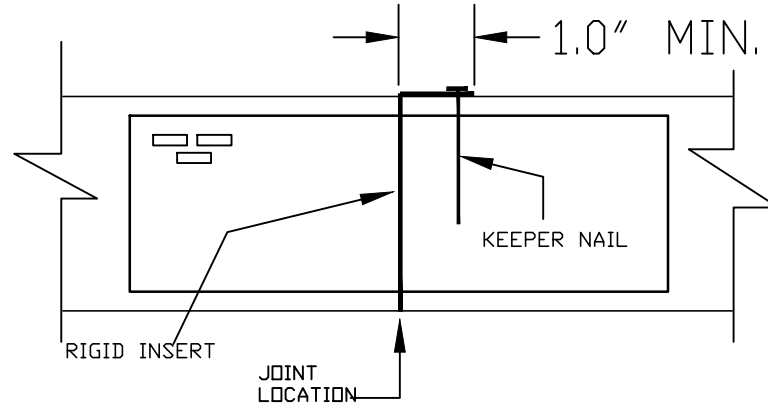

OPTION #2:

APPLY A 20 GAGE MINIMUM METAL INSERT WITH SLOTTED TEETH BETWEEN BUTTED ENDS OF COMPRESSION CHORD MEMBERS TO FULLY COVER THE JOINT BEARING AREA. HAMMER RIGID INSERT SECURELY IN PLACE AND FLUSH WITH BUTTED END.

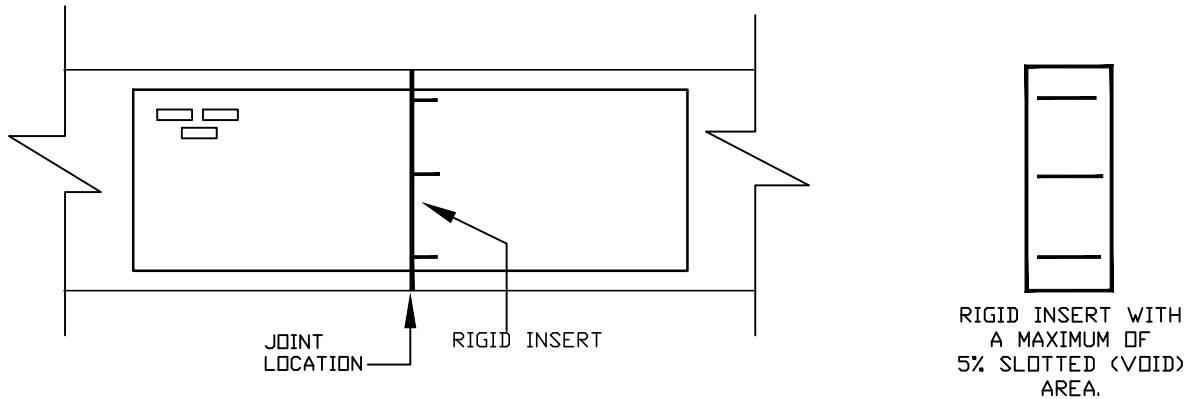

WARNING: READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT: FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.
 Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.
 Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.
 A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.
 For more information see this Job's general notes page and these web sites:
 ALPINE: www.alpinet.com; TPI: www.tpinst.org; SBCA: www.sbca.components.com; ICC: www.iccsafe.org

| | | |
|-----------|-----|-------------------|
| TC LL | PSF | REF RIGID INSERT |
| TC DL | PSF | DATE 10/01/14 |
| BC DL | PSF | DRWG RIGINSRT1014 |
| BC LL | PSF | |
| TOT. LD. | PSF | |
| DUR. FAC. | | |
| SPACING | | |