


Blocking Reinforcement Detail

Blocking specified on the Engineer's sealed design drawing does not replace or satisfy the blocking requirements of referenced building codes and standards for braced walls and roof diaphragms. Refer to the Building Designer's specifications for wall blocking needed to meet referenced building codes and standards. Blocking used to meet referenced building codes and standards for braced walls and roof diaphragms may be used in place of blocking specified on Alpine Truss Design Drawing if blocking is properly placed and attached per referenced building codes and standards.


Option 1 - Blocking Between Trusses

Apply blocking using 2x stress-graded lumber attached perpendicular to and between trusses at the heel or interior bearing. Blocking is to be sized as specified on Alpine truss drawing. Attach blocking at each end to trusses with (3) equally spaced 0.131"x3" nails driven through truss members into end of block or (2) equally spaced 0.131"x3" nails, toe-nailed through block into truss members. Blocking shall be placed on both sides of truss requiring reinforcement and shall be sized to fit tight between trusses.

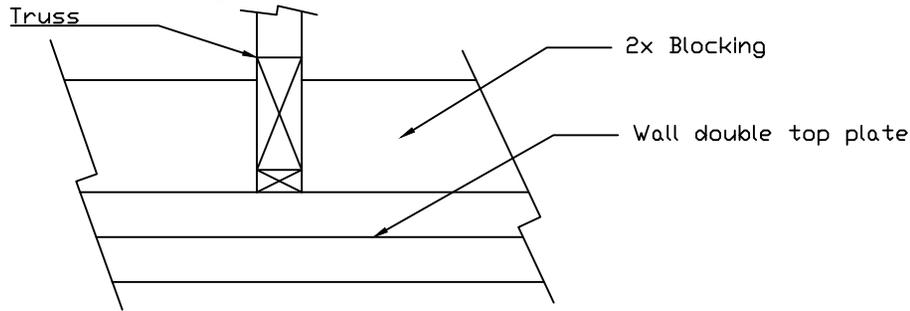


Option 3-Truss Attachment to Wall Sheathing

For truss heel heights between 9.25" and 15.25" and where the outside edge of truss heel aligns with the outside face of the wall studs below, wood structural panel sheathing extending above the top plate shall be fastened to truss with (5) 0.131"x2.5" nails into end of truss members with nail quantities divided proportionately between contacted truss members. The depth of sheathing above wall plate must meet or exceed the blocking reinforcement depth as specified on the Engineer's sealed design drawing. Sheathing shall be attached to the wall in accordance with referenced building codes and standards.

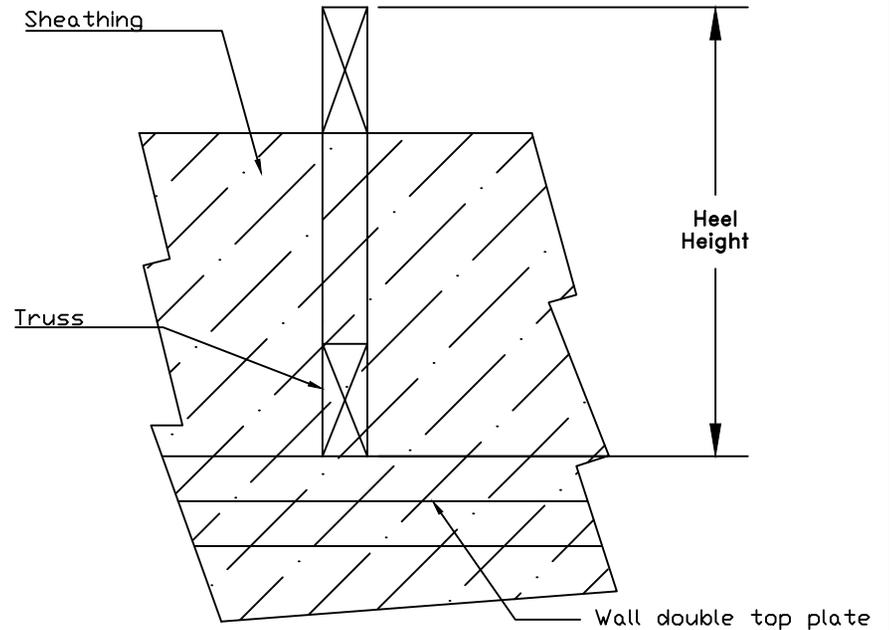

Option 2- Scab Reinforcement

Attach a vertical scab using 2x4 stress-graded lumber to one side of the truss at the bearing. Attach with 2 equal spaced staggered rows of 0.131"x3.0" nails @ 4" o.c. The scab shall be the full truss depth at the heel. Vertical scab is not a replacement or substitution for any bearing block requirements that may be specified on the Engineer's sealed design drawing.

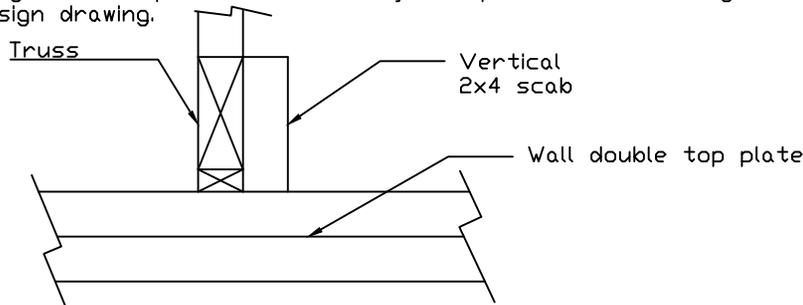

*****WARNING*** READ AND FOLLOW ALL NOTES ON THIS DRAWING
IMPORTANT FURNISH THIS DRAWING TO ALL CONTRACTORS INCLUDING THE INSTALLERS.**

Trusses require extreme care in fabricating, handling, shipping, installing and bracing. Refer to and follow the latest edition of BCSI (Building Component Safety Information, by TPI and SBCA) for safety practices prior to performing these functions. Installers shall provide temporary bracing per BCSI. Unless noted otherwise, top chord shall have properly attached structural sheathing and bottom chord shall have a properly attached rigid ceiling. Locations shown for permanent lateral restraint of webs shall have bracing installed per BCSI sections B3, B7 or B10, as applicable. Apply plates to each face of truss and position as shown above and on the Joint Details, unless noted otherwise. Refer to drawings 160A-Z for standard plate positions.

Alpine, a division of ITW Building Components Group Inc. shall not be responsible for any deviation from this drawing, any failure to build the truss in conformance with ANSI/TPI 1, or for handling, shipping, installation & bracing of trusses.

A seal on this drawing or cover page listing this drawing, indicates acceptance of professional engineering responsibility solely for the design shown. The suitability and use of this drawing for any structure is the responsibility of the Building Designer per ANSI/TPI 1 Sec.2.

For more information see this Job's general notes page and these web sites:
ALPINE: www.alpineitw.com; TPI: www.tpinst.org; SBCA: www.sbcacomponents.com; ICC: www.iccsafe.org

ALPINE
AN ITW COMPANY

155 Harlem Ave
North Building, 4th Floor
Glenview, IL 60025

TC LL	PSF	REF	---
TC DL	PSF	DATE	09/11/25
BC DL	PSF	DRWG	CNBLKREINF1120
BC LL	PSF	-ENG	
TOT. LD.	PSF		
DUR. FAC.			
SPACING			